



# FIRE-RATED COMPACT WASHING MACHINE OUTLET BOX

696R SERIES

OxBox™

## SPECIFICATION

Sioux Chief 696 series OxBox™ fire-rated outlet box shall be used where necessary in plumbing systems. Unit shall allow for mounting on-stud or between studs, and include plated, 1/4-turn valves with 3/4" MHT outlets. Valve outlets shall be provided with tamper-resistant test caps. Valve handles on arrester models can be operated together (single throw) or independently. Metal support bracket can be installed into top/bottom tracks of box. Drain box shall have a testable 5/8" nipple on drain cover. Designed in accordance with IAPMO PS 54-2021a.

## MATERIALS

**Valve body:** Forged brass<sup>1</sup>

**Valve shank:** Brass<sup>1</sup> or CPVC with 304SS grip ring, brass nut, silicone seal

**Outlet box:** ABS

**Box frame:** Fire-rated ABS

**Frame extension:** Fire-rated ABS<sup>2</sup>

**Arrester body:** 304SS barrel with brass<sup>1</sup> body

**Arrester piston:** Polypropylene with EPDM o-rings

**Fire guard:** intumescent material

## CERTIFICATIONS/APPROVALS

NSF-372 compliant<sup>1</sup>, IAPMO listed box and valves, Arresters meet ASSE 1010, Valves meet ASME A112.18.1 Listed by Warnock Hersey (see back side) System design number: SC/WA120, W/N 14409

## VALVE/ARRESTER WORKING LIMITS


**Max Working Temperature:** 200° F

**Max Testing/Working Pressure:** 150 PSIG

## DIMENSIONS

- A:** Frame width 5-7/8"
- B:** Frame height 7-1/4"
- C:** Box width 4"
- D:** Box height 5-1/2"
- E:** Box depth 3-1/2"
- F:** Supply inlet 1/2" Nom. 2" O.C.
- G:** Supply outlet 3/4" Male hose thread
- H:** Drain connection 2" Sch. 40 hub
- I:** Test nipple 5/8" O.D.  
Bracket length 17"

ITEM # SUBMITTED	_____
JOB NAME	_____
LOCATION	_____
ENGINEER	_____
CONTRACTOR	_____
PO#	_____ TAG _____

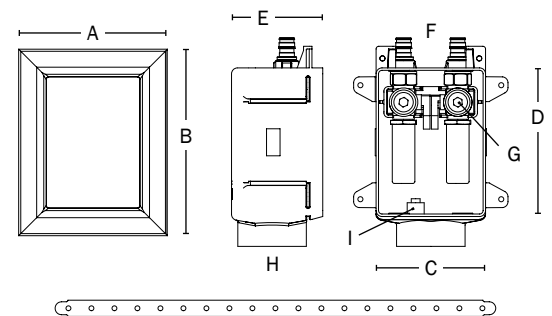

Create Item Number

**696AB**

e.g. **696RG2303WF**: Fire-rated compact washing machine outlet box with frame; no-lead valves, F1960 connection

**ARRESTERS A**  
**RG2303** = No arresters  
**RG2313** = With arresters

**SUPPLY CONNECTION B**  
**CF** = CPVC (male)  
**WF** = F1960 PEX

Accessories - Available Separately:  
 696-EX: Frame extension<sup>2</sup>

<sup>1</sup> C69300 material is DZR and SCC resistant, compliant with NSF-61 & 372, and compliant with California No Lead Plumbing Law  
<sup>2</sup> 696-EX frame extension available separately. Use with 2 layers of drywall for 2-hour specifications

# FIRE-RATED OXBOX

## DESIGN SPECIFICATION

### 1. WALL CONSTRUCTION

- Wood or metal stud construction, max 100 in.<sup>2</sup> of penetrations per 100 ft<sup>2</sup> of wall.
- 16" or 24" on-center stud construction.
- Can be installed with a gap between front and back wall assemblies (UL Design # U341) (Figure 2).
- Single-layer 5/8" gypsum construction with 1-hour fire rating.
- Double-layer 5/8" gypsum construction with 2-hour fire rating.  
Frame extensions can be used.
- Boxes cannot be installed back-to-back.

### 2. PIPE/BOX SUPPORT

- Each outlet box shall be installed in a separate stud bay and attached to the stud (Figure 3 & 4). Fire rating does not apply to installations of two or more boxes in the same stud bay.
- Supplied support bar.
- Supply lines to be installed using ordinary methods.
- Drain line to be supported using ordinary methods.

### 3. PIPE MATERIAL

- 2" or larger metallic, PVC, or ABS DWV pipe.
- Metallic or plastic water supply pipe.

### 4. FIRESTOP DEVICE

Sioux Chief fire-rated OxBox uses fire-rated resin. Boxes have 4" x 4" intumescent adhesive pads factory installed on the back of boxes.

NOTE: Gaps up to 1/2" around box can be sealed with drywall plaster. Larger gaps require firestop sealant applied to opening spanning entire drywall depth

FIGURE 1


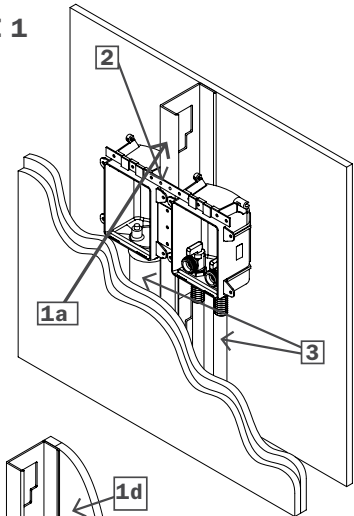


FIGURE 2

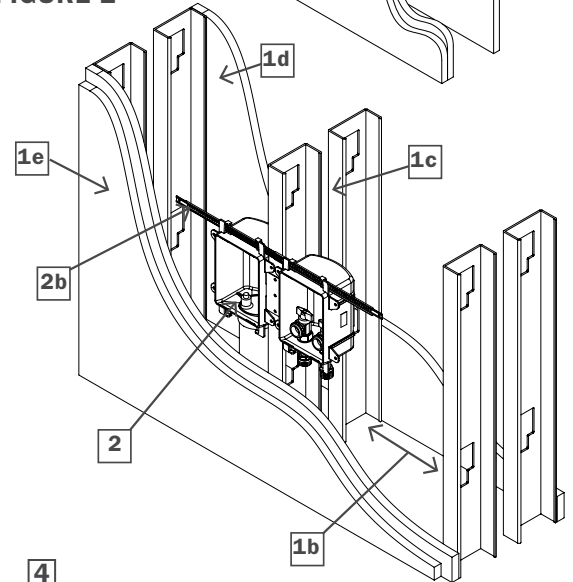

UL D.#U341

"over stud" installation

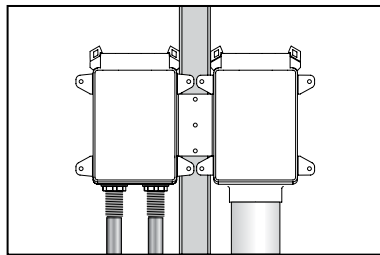


FIGURE 3

"separate stud bay" installation


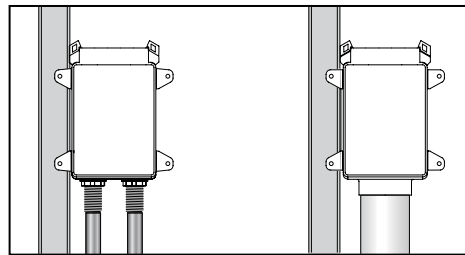


FIGURE 4

4  
Fire-rated ABS

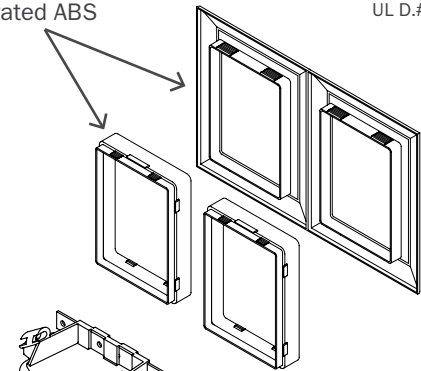

Intumescent pads

**THE FIRE-RATED OXBOX IS CERTIFIED BY INTERTEK/WARNOCK HERSEY TO THE FOLLOWING FIRE RATING STANDARDS:**

#### ASTM E-814

2 hours (F), 90 mins (T)  
for 2-hour design  
1 hour (F), 31 mins (T)  
for 1-hour design

#### ASTM E119

#### CAN/ULC S115

2 hours (F), 90 mins (T)  
for 2-hour design  
1 hour (F), 31 mins (T)  
for 1-hour design

#### UL 1479

